


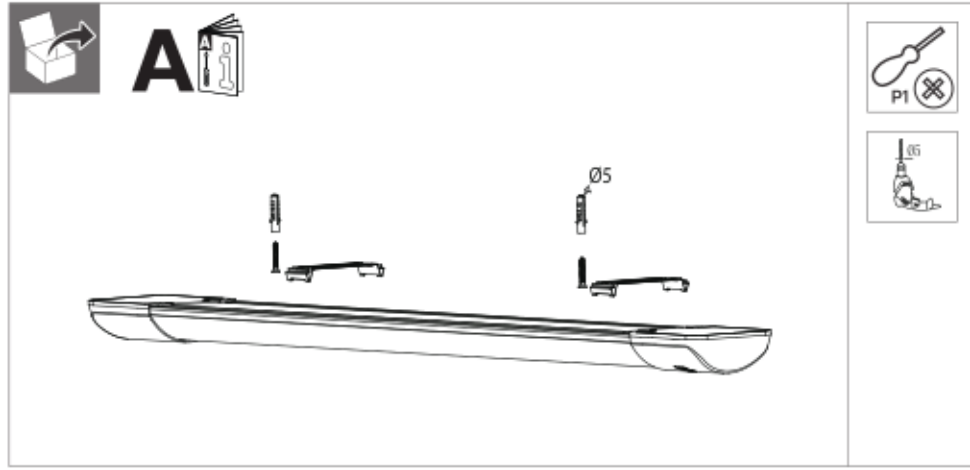
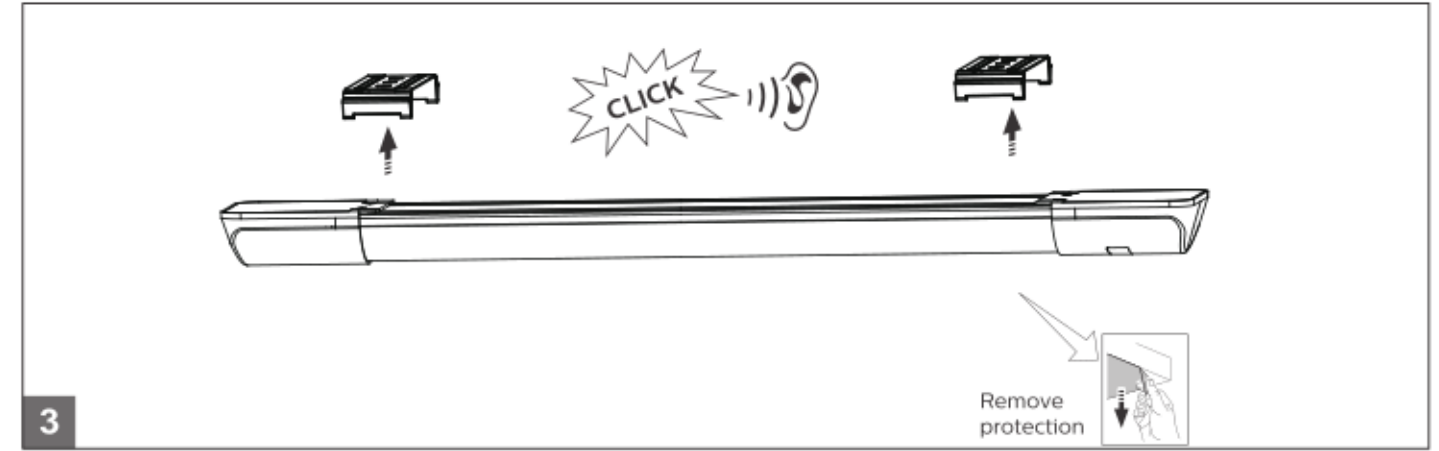
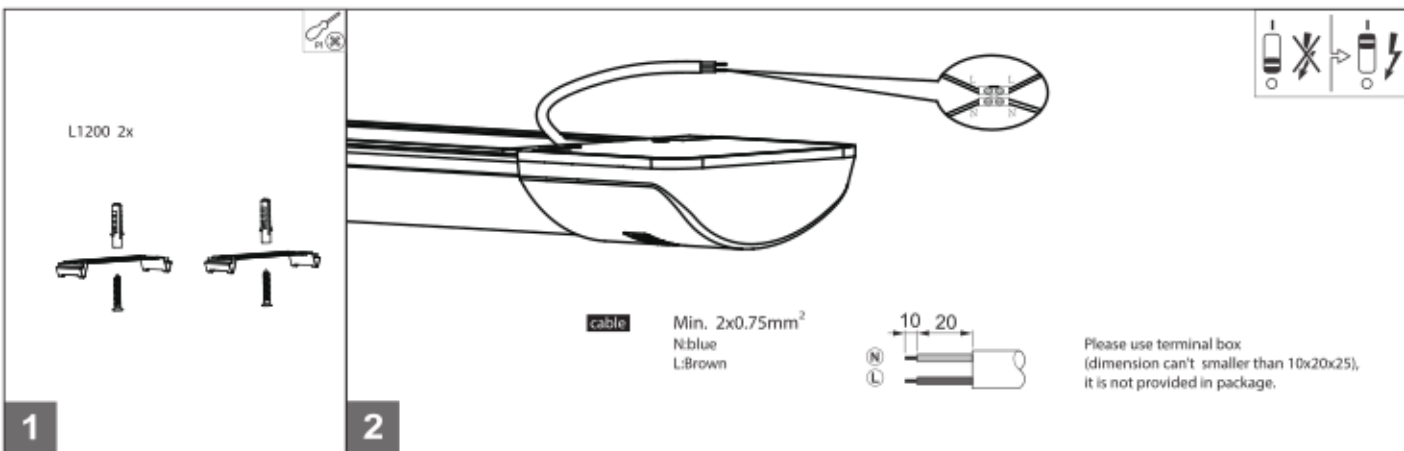


# PHILIPS

## Projectline Batten

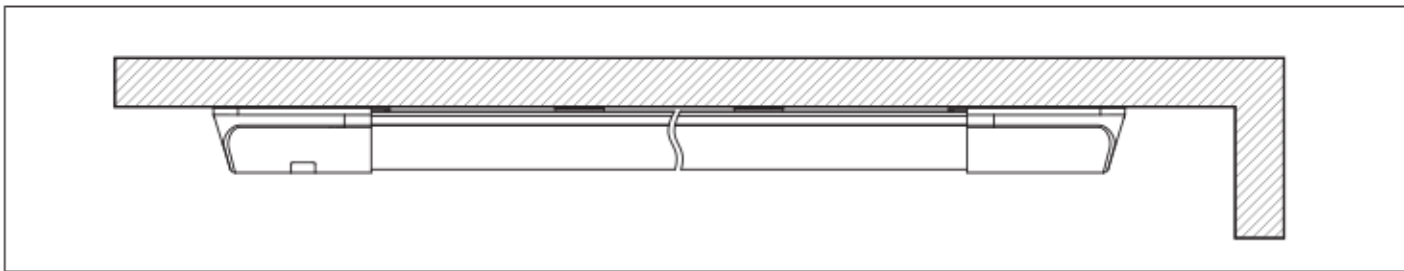

Type	System lumen (Lm)	CCT	P(W)	Energy efficiency class of light source	L	A	kg
Projectline Batten 60 1440lm 3000K	1440	3000K	16W	F	600	255-385	0.155
Projectline Batten 60 1600lm 4000K	1600	4000K	16W	F	600	255-385	0.155
Projectline Batten 120 2700lm 3000K	2700	3000K	30W	F	1200	400-600	0.255
Projectline Batten 120 3000lm 4000K	3000	4000K	30W	F	1200	400-600	0.255

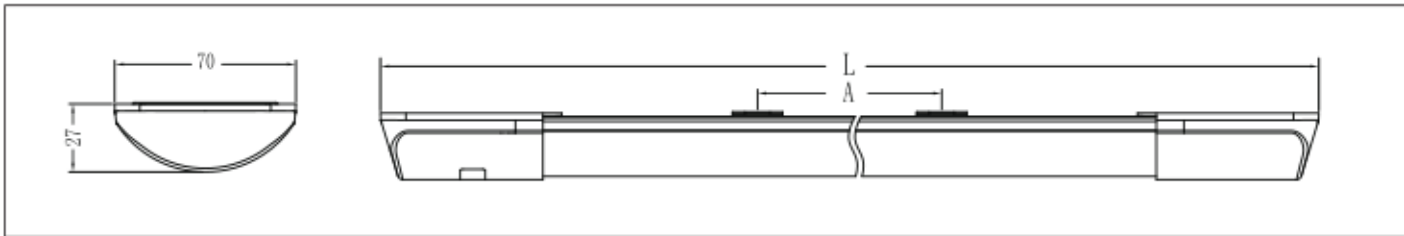

**!**

- The luminaire shall be installed by a qualified electrician and wired in accordance with the latest IEE electrical regulations or the national requirements.
- The LED driver is not serviceable and not replaceable.
- The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.
- Luminaire must not be used or stored in corrosive environments where hazardous materials such as sulphur, chlorine, phthalates, etc, are present.

**ATTENTION**  
OBSERVE PRECAUTIONS FOR HANDLING ELECTROSTATIC SENSITIVE DEVICES